



Plot Date: 2/20/2013 8:38:42 AM Filename: \\wbfile\groups\Engineering\CAD\Standards\SignetP-700.dgn

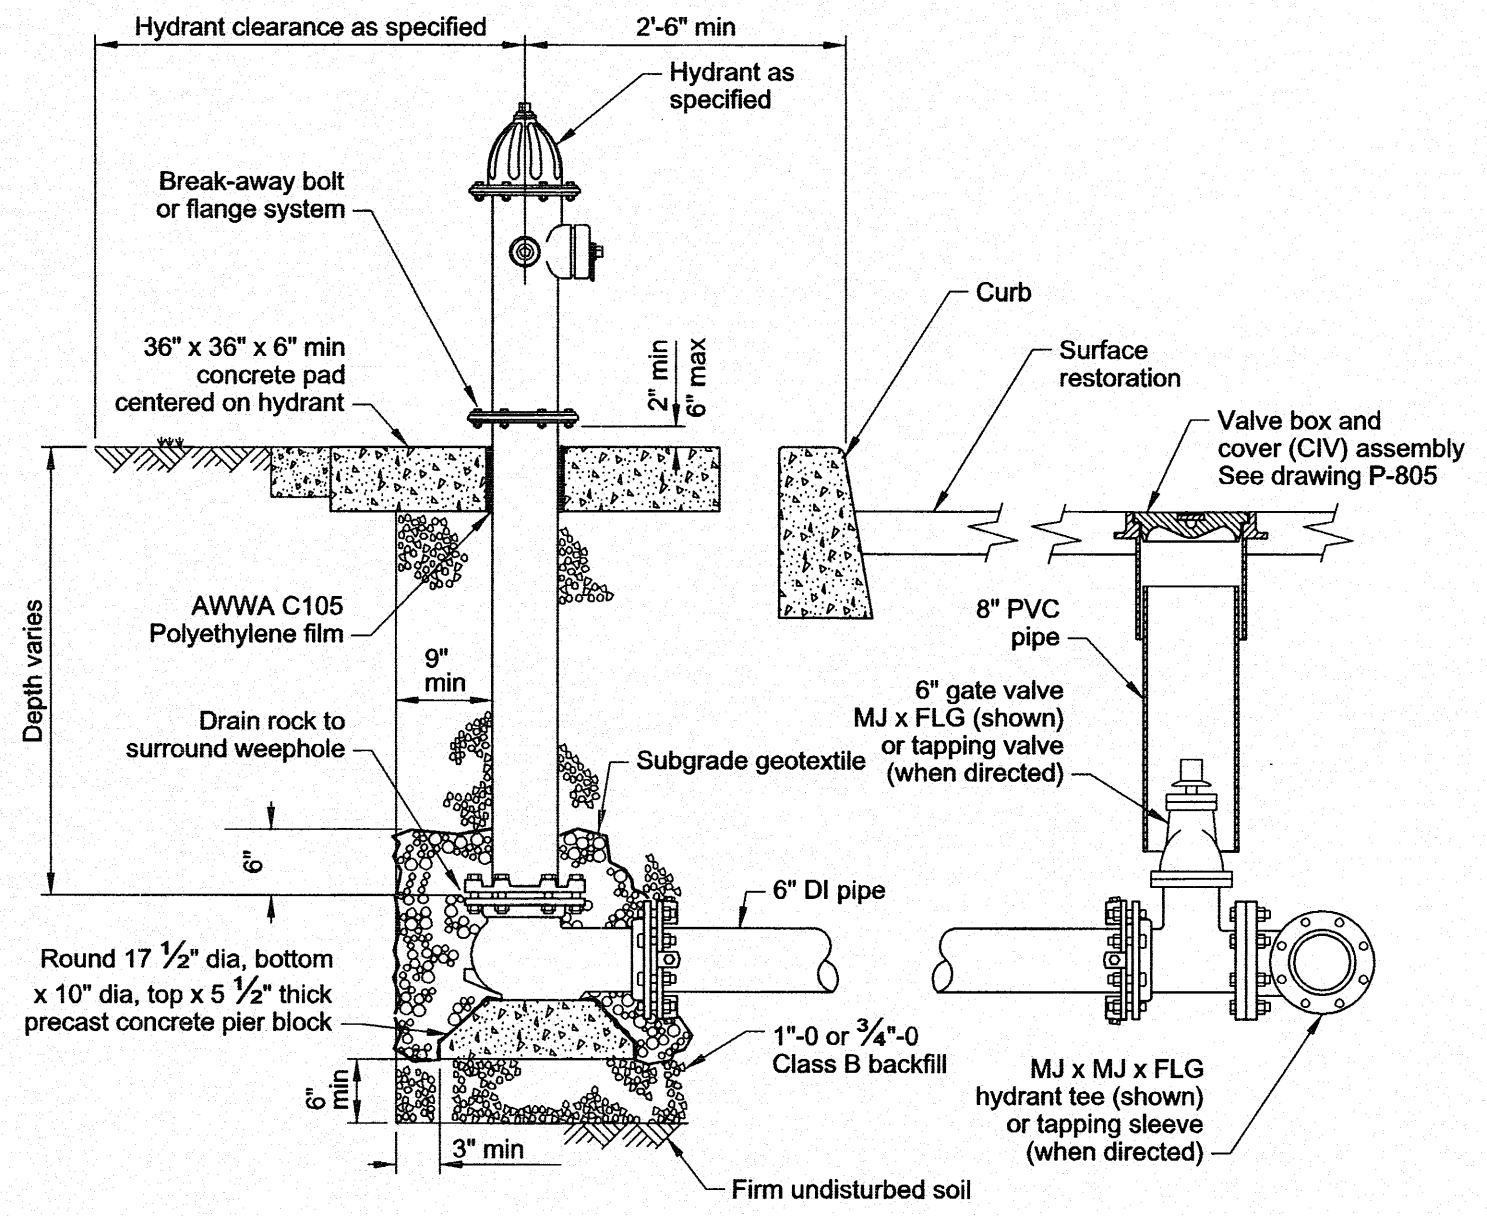

Notes:

1. All joints to be restrained.
2. Hydrant to be painted as specified.
3. Concrete pad and sidewalk replacement as needed to match existing scoring pattern.
4. Extend concrete pad to curb or sidewalk when the distance between the concrete pad and the curb or sidewalk is 1' or less.

<p>The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user.</p>	 <p>PORTLAND WATER BUREAU CITY OF PORTLAND, OREGON</p> <p><i>[Signature]</i> Chief Engineer</p>	
	<p>Standard Drawing Title</p> <p style="text-align: center;">FIRE HYDRANT ASSEMBLY</p>	
<p>Note: All material and workmanship shall be in accordance with City of Portland Standard Construction Specifications.</p>	<p>Effective Date February 20 2013</p>	<p>Standard Drawing No.</p> <p style="text-align: center;">P-700</p>
	<p>Calc. Book No. PWB 1</p>	
	<p>Baseline Report Date April 6 2009</p>	