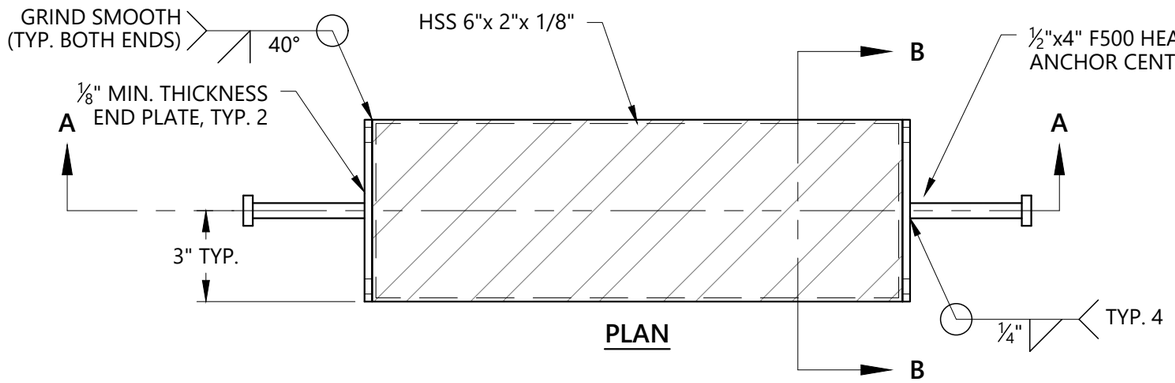

PLAN

NOTES:

1. HEADED CONCRETE ANCHORS SHALL MEET THE REQUIREMENTS OF ASTM A-108.
2. HSS 6 X 2 X 1/8 TUBE SHALL MEET THE REQUIREMENTS OF ASTM A-500 GRADE B.
3. END PLATES SHALL MEET THE REQUIREMENTS OF ASTM A-36.
4. ENTIRE ASSEMBLY SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A-123.

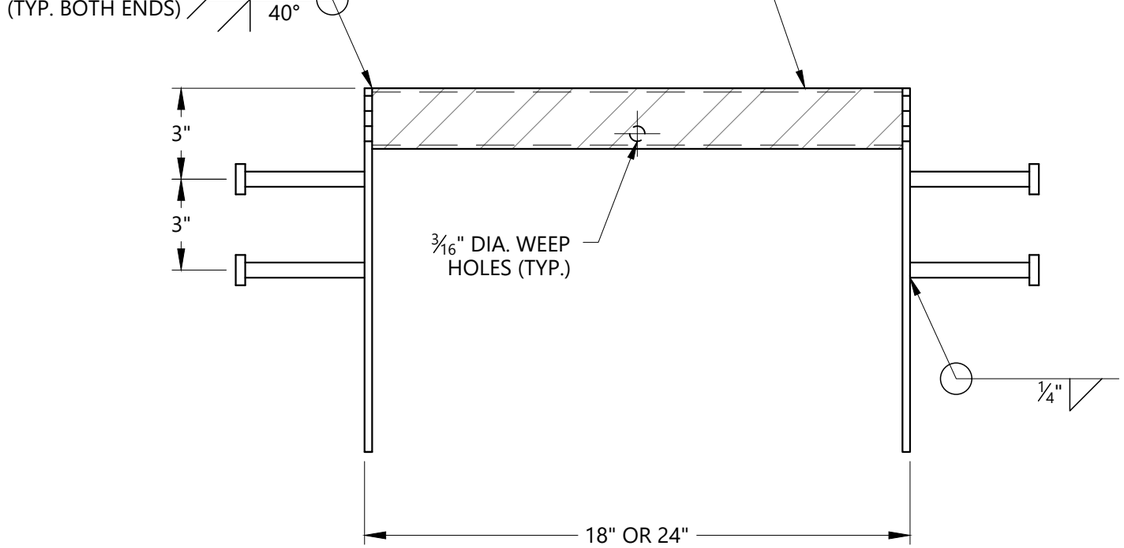

SECTION A-A

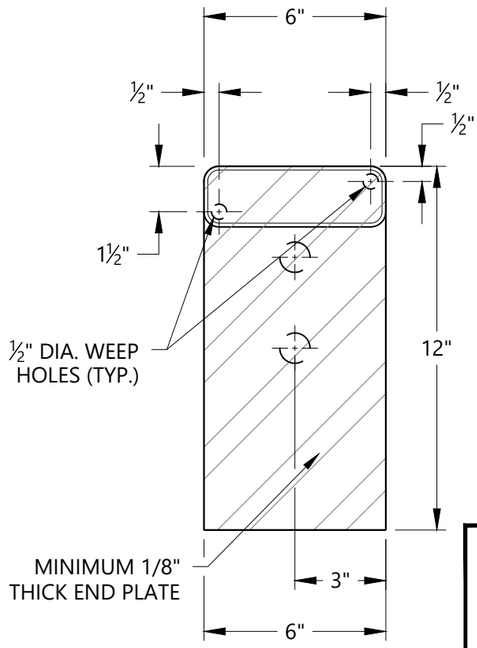

SECTION B-B

The selection and use of this Standard Detail, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user.

Bureau of Environmental Services
CITY OF PORTLAND, OREGON
Digitally signed by Paul Suto
Date: 2025.03.10 09:14:04 -07'00'
Chief Engineer

Standard Detail Title

CONCRETE INLETS, TYPE METAL
METAL INLET ASSEMBLY

Note:
All material and workmanship shall be in accordance with the City of Portland Standard Construction Specifications.

Effective Date: 03-01-2025
Calc. Book No.: N/A
Baseline Report Date: N/A

Standard Detail No.
P-302

P-302_CONCRETE_INLET_TYPE_METAL_METAL_INLET_ASSEMBLY.DWG 2/28/25 11:57 AM SPEREZ