



Amanda Fritz, Commissioner
Gabe Solmer, Administrator
1120 SW Fifth Avenue, Room 405
Portland, Oregon 97204-1926
503-823-7404
portlandoregon.gov/water



Oct. 19, 2020

First First2 Last
Address
City, State Zip

Dear Property Owner,

The Portland Water Bureau (PWB) has been evaluating alignment alternatives for new pipelines. These pipelines will be constructed to connect existing pipelines to a new filtration facility that will be built on property PWB owns near SE Carpenter Lane. The filtration facility and pipelines are being planned to comply with the federal Long-Term 2 Enhanced Surface Water Treatment Rule and must be completed by September 30, 2027.

In October 2020, PWB selected a pipeline alignment that is located on or near your property. A copy of the selected pipeline route is attached for your reference.

We want to ensure we have your correct information to keep you updated throughout the process. Please complete the enclosed contact form and return it using the enclosed prepaid envelope. Alternatively, you can complete this information online at:
www.surveymonkey.com/r/neighborcontact

If you have questions or concerns, please do not hesitate to reach out to me at 503-865-6039 or Bonita.Oswald@portlandoregon.gov. For more information about the project and to sign up for the project e-newsletter, visit portland.gov/bullrunprojects.

Sincerely,

Bonita Oswald, Project Communications
Bonita.Oswald@portlandoregon.gov
503-865-6039



Contact Information Form

Please complete this form to provide your contact information. Our Bull Run Filtration Project team will use this information to keep you up to date and provide advance notice of field activities. This form can also be completed online at: www.surveymonkey.com/r/neighborcontact

Property Owner Name(s): _____

Subject Property Address: _____

City, State, Zip code: _____

Mailing Address: _____

Primary Phone #: _____ Home Mobile Name: _____

Secondary Phone #: _____ Home Mobile Name: _____

Alternative Phone #: _____ Home Mobile Name: _____

Primary Email: _____

Check this box to use this email to sign up for Bull Run Treatment Project updates

Secondary Email: _____

Check this box to use this email to sign up for Bull Run Treatment Project updates

What other information would you like our team to be aware of to help communications go smoothly? (Do you have a renter or other resident who you'd like to receive notifications? Do you have animals at your property that may need to be moved when field work is occurring?)



Bull Run
TREATMENT
PROJECTS

Filtration



Bull Run Filtration Project

Preferred Pipeline Routes - October 2020

Legend


- Arterial Roads
- Local Roads
- Filtration Facility
- Streams
- New Intertie
- Existing Intertie

Raw Water

- RW Alt 1
- RW Alt 1A
- Trenchless

Finished Water


- FW Alt 3
- FW Alt 5A
- FW Alt 5 Optional

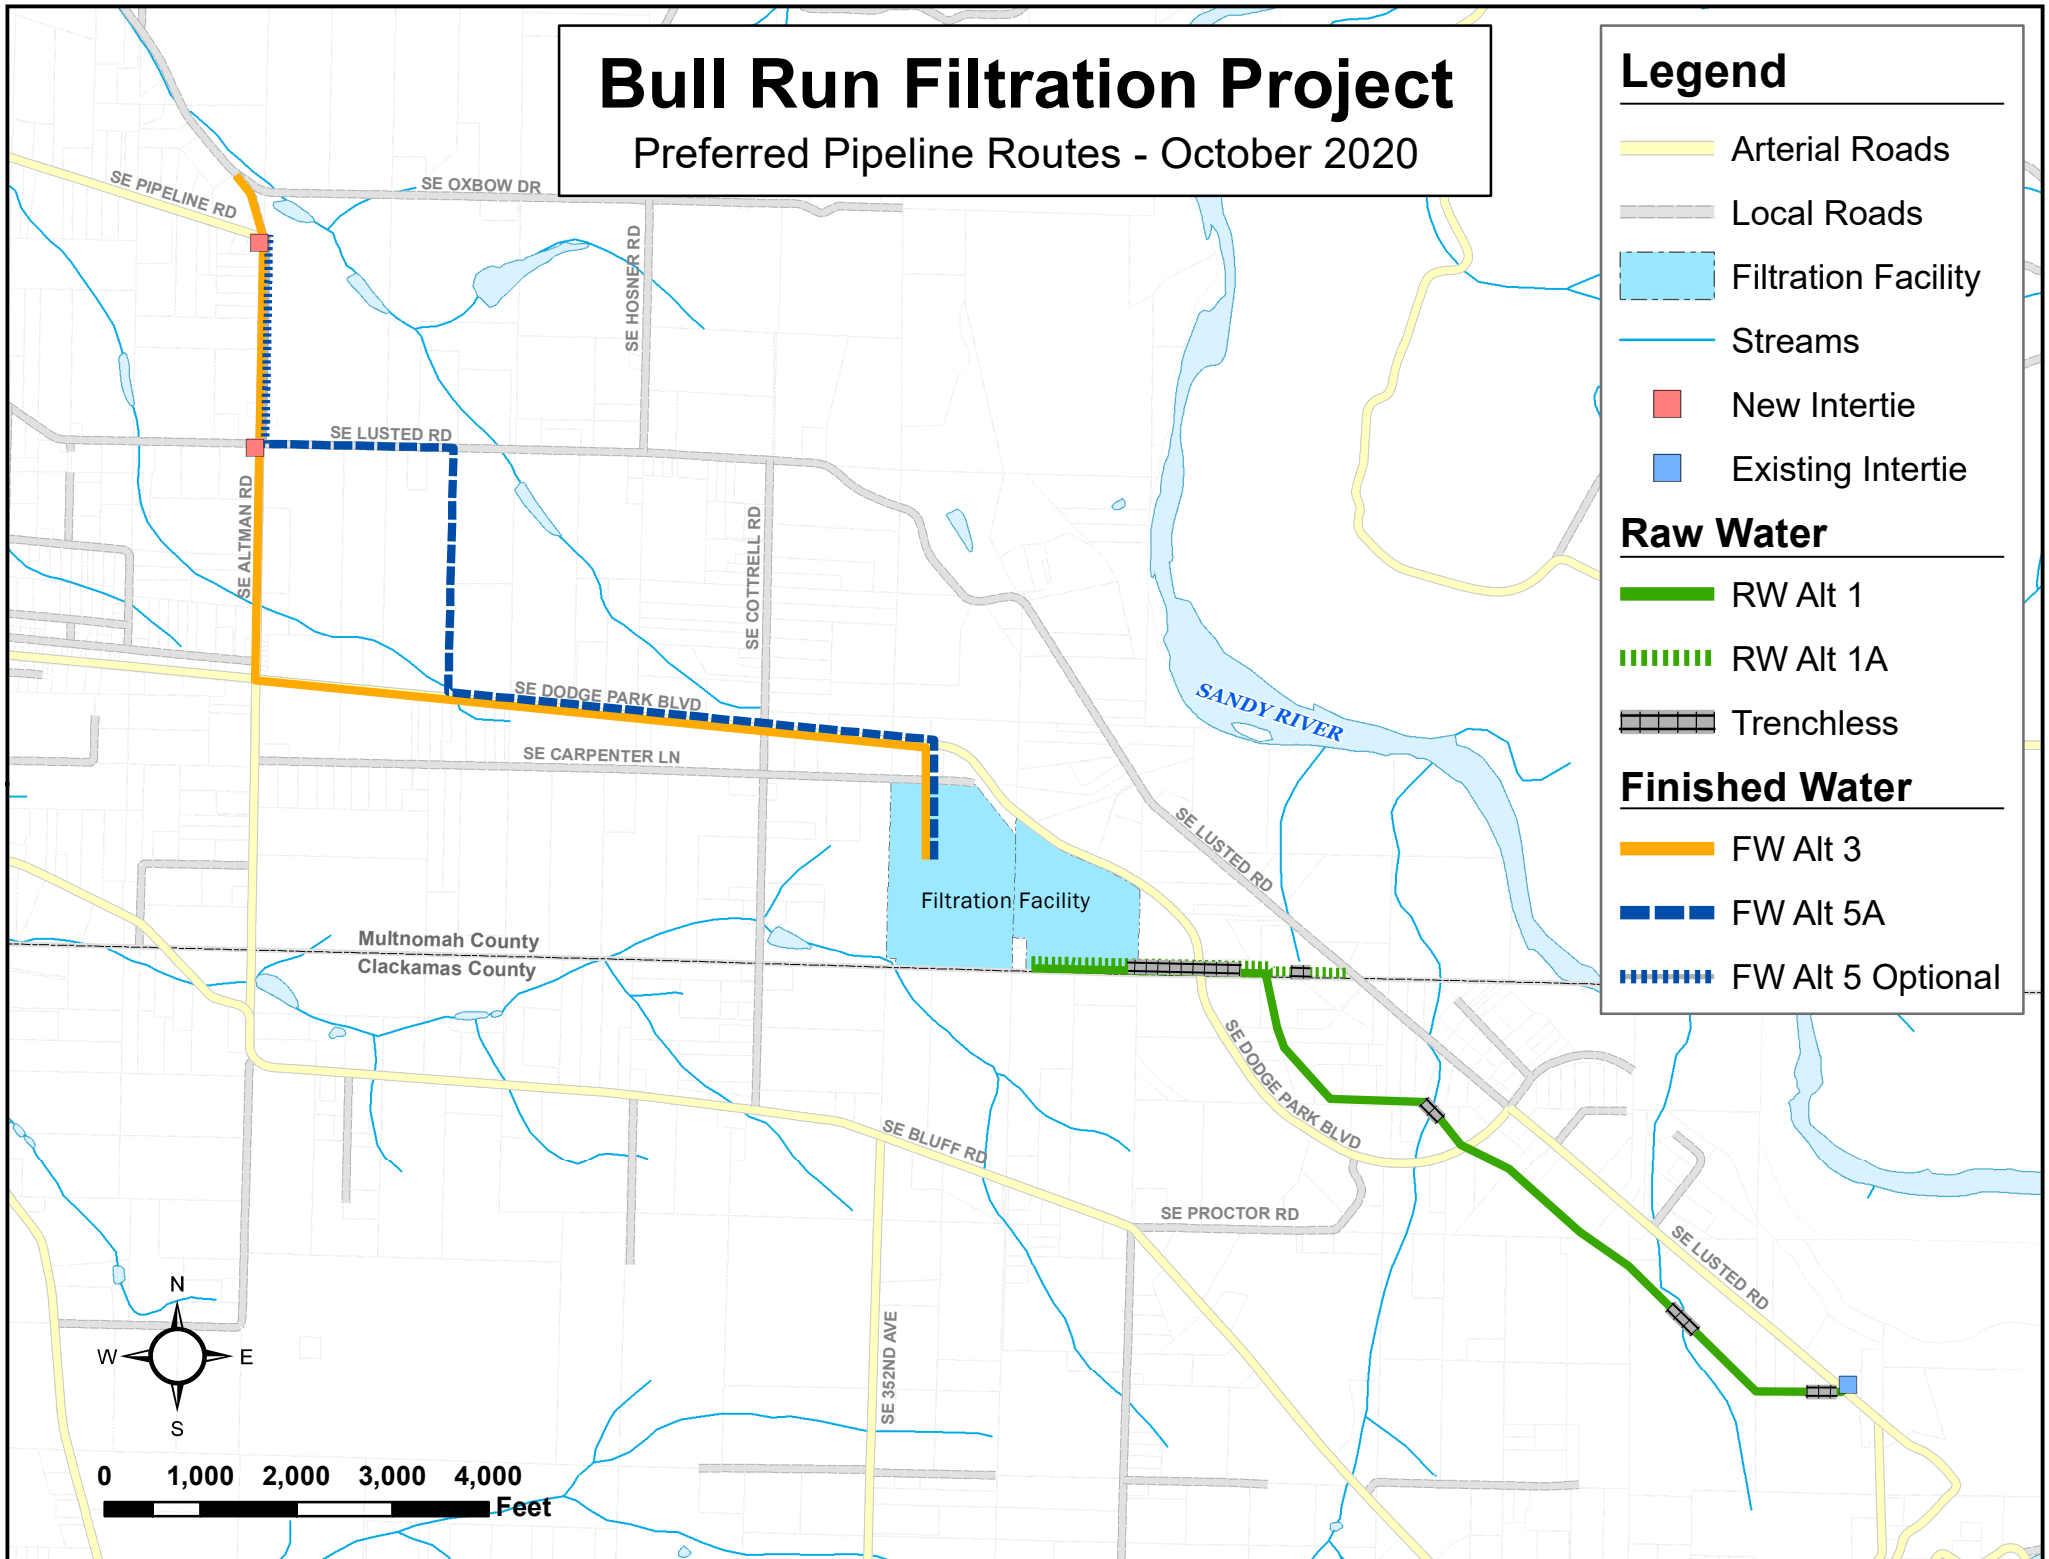

Multnomah County
Clackamas County

Filtration Facility

SANDY RIVER



0 1,000 2,000 3,000 4,000 Feet